

Manifold Recirculation System Prepiped 61-25 Mixing Valve with Recirculation Pump and Mounting Strut

61-25 valve is
ASSE 1017 Approved




ASSE Lead Free Certified



Certified to
CSA B125.3

Refer to the typical installation shown
in the 61 series bulletin.

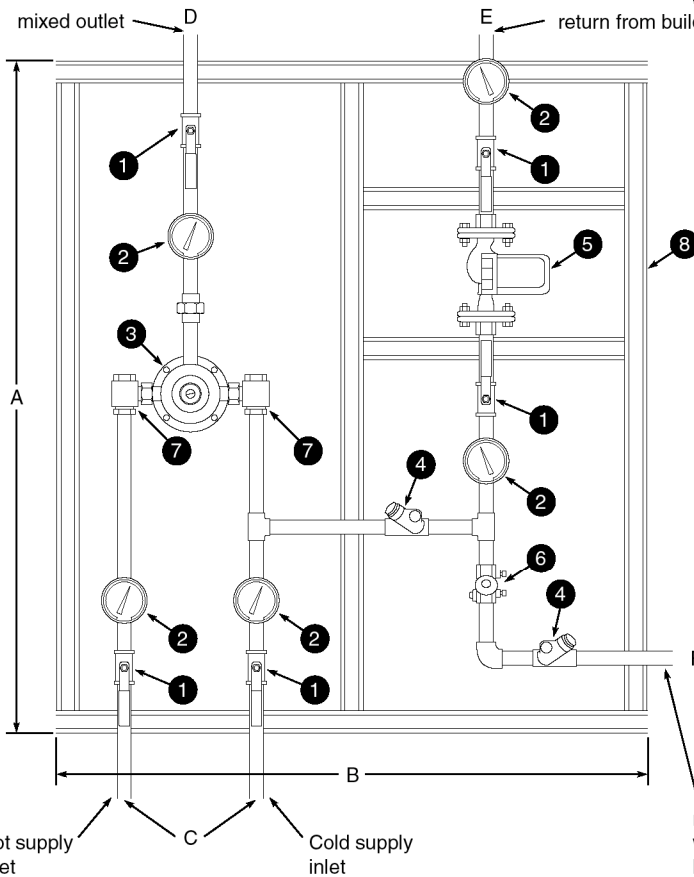

- 1. Full Port Ball Valve
- 2. Thermometer
- 3. Lawler 61-25 Series Valve
- 4. Check Valve
- 5. Recirculation Pump
- 6. Circuit Setting Balancing Valve
- 7. Stop & Check Valve
- 8. Epoxy-coated Strut

Exposed mixing valve shall be of the thermostatic type with liquid-filled motor. In the event of interruption of hot or cold water supply or thermostat failure, the valve shall be designed to restrict flow by use of a sliding piston control mechanism with reverse seat closure. The valve shall maintain output temperature for changes in inlet pressures or temperature. Valve construction shall have bronze body and stainless steel piston and liner. Piped and cabinet assemblies which have a downstream shutoff device shall include union end stop and check valves with removable strainer on each inlet.

Mixing valve shall be incorporated into a pre-piped manifold system which includes a recirculating pump, circuit setting balancing valve, thermometers, ball valves and mounting strut.

TEMP. RANGE	SET POINT	
50° to 100°F	80°F	<input type="checkbox"/>
85° to 135°F	110°F	<input type="checkbox"/>
100° to 150°F	130°F	<input type="checkbox"/>

DIMENSIONS:

A	34 1/2"	D	61-25 3/4"
B	27"	E	To be specified by engineer
C	61-25 3/4"	F	To be specified by engineer

GPM CAPACITIES – Series 61

Pressure Drop PSI	5	10	20	30	45	60	80
Valve Number	Capacity-GPM						
61-25	6.0	10	14	18	25	30	34

LPM CAPACITIES – Series 61

Pressure Drop PSI	5	10	20	30	45	60	80
Valve Number	Capacity-LPM						
61-25	22.7	37.8	53	68	94.6	113	128

Minimum flow is 1/2 gpm when properly installed.

Recirculation pipe size _____
 Aquastat _____
 Recirculation pump _____
 Test connection and circulator power switch (optional)

LAWLER
MANUFACTURING CO., INC.
 5330 East 25th Street
 Indianapolis, Indiana 46218
 Phone (317) 261-1212
 Fax (317) 261-1208