



5330 East 25th St. Indianapolis, IN 46218 Phone (317) 261-1212 Fax (317) 261-1208



Neptune EMX 200 Electronic Mixing Valve Eng. No. 943040

Pressure Drop PSI		5	10	20	30
Valve	Inlet Size	CAPACITY GPM			
NEPTUNE EMX 200	2	102	145	205	252

Minimum flowrate 1/4 gpm in properly recirculated system. 5 gpm minimum recirculation flow rate.

- · 2" inlets and outlet
- · Stainless Steel Construction
- · ASSE 1017 and NSF 372 (lead free) listed
- · Maximum operating pressure: 150 psi
- Controls water temperature to +/- 2°F in accordance with ASSE 1017
- Low Load algorithm keeps temperature steady in low demand periods
- · Fails "last position" during power failure
- Automatic Hot/Cold water shutoff upon cold/hot water inlet supply failure


- Programmable high temperature alarm function
- Programmable set point range between 95°F to 140°F (Default set temperature 120°F)
- Control box supplied with 4 ft. 120 VAC power cord and NEMA 4 enclosure
- · Mod bus communication standard
- Easy integration into BMS system
- · Operating Voltage: 24 VAC
- · Simple user commissioning and setup
- · Displays outlet temperature
- · Removeable and serviceable thermocouple probe
- Factory Assembled and Tested



Valve Number



5330 East 25th St. Indianapolis, IN 46218 Phone (317) 261-1212 Fax (317) 261-1208

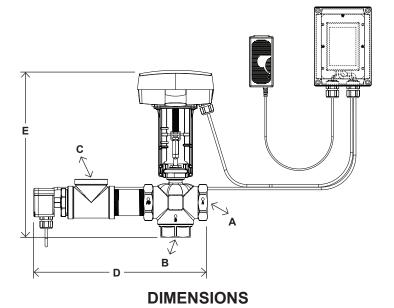

EMX 200 2" 2" 2" 16" 16" Dimensions are for reference purposes only. For rough-in dimensions please refer to Lawler's Revit/BIM models found at temperedwater.com.

B N.P.T.

C N.P.T.

D

Е

Neptune EMX 200 Electronic Mixing Valve Eng. No. 943040

Typical Installation

Install the mixing valve below the hot water tank or heater. If this is not possible, pipe in a heat trap as shown in Figure 1 with an approximate 2' drop.

Connect a tempered water return line as shown in Figure 1. This allows flow through both ports of the mixing valve during periods of no draw.

If a dual temperature system is used, a separate recirculating loop and pump are required to return high temperature hot water to the water heater. See Figure 2.

Install the water heater per manufacturer's instructions.

Figure 1 When used in a single temperature recirculating system

A N.P.T.

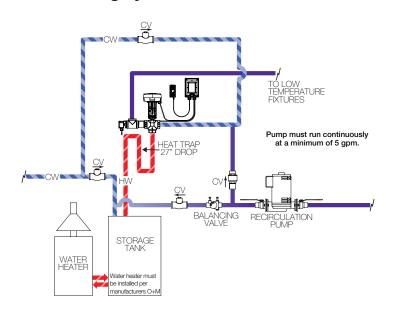


Figure 2
When used in a dual temperature recirculating system

